



RAIN WATER HARVESTING -1 TANK CAPACITY 1500 L


Director
R.D. Engineering College
Duhai, Ghaziabad

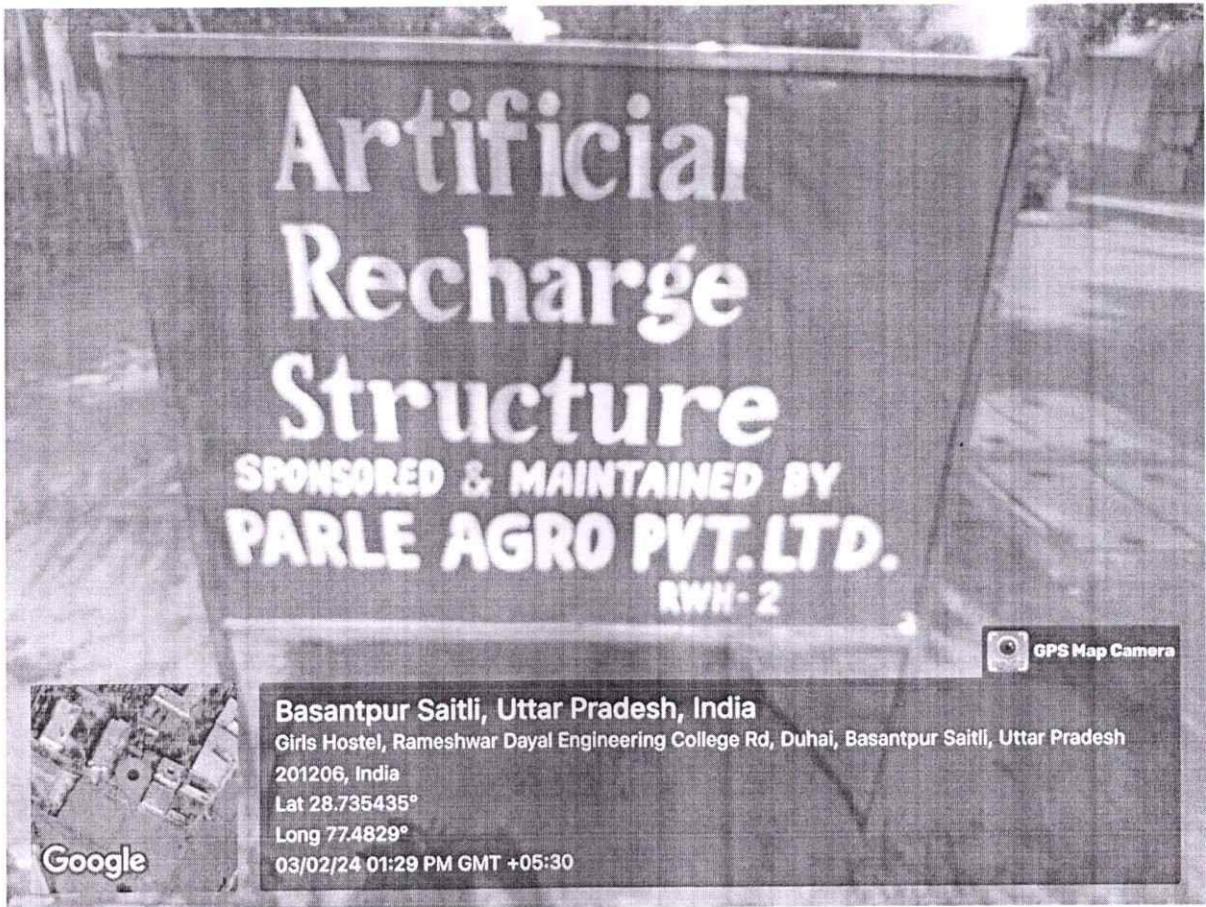

RAIN WATER HARVESTING -2 TANK CAPACITY 1500 L


Director
R.D. Engineering College
Duhai, Ghaziabad

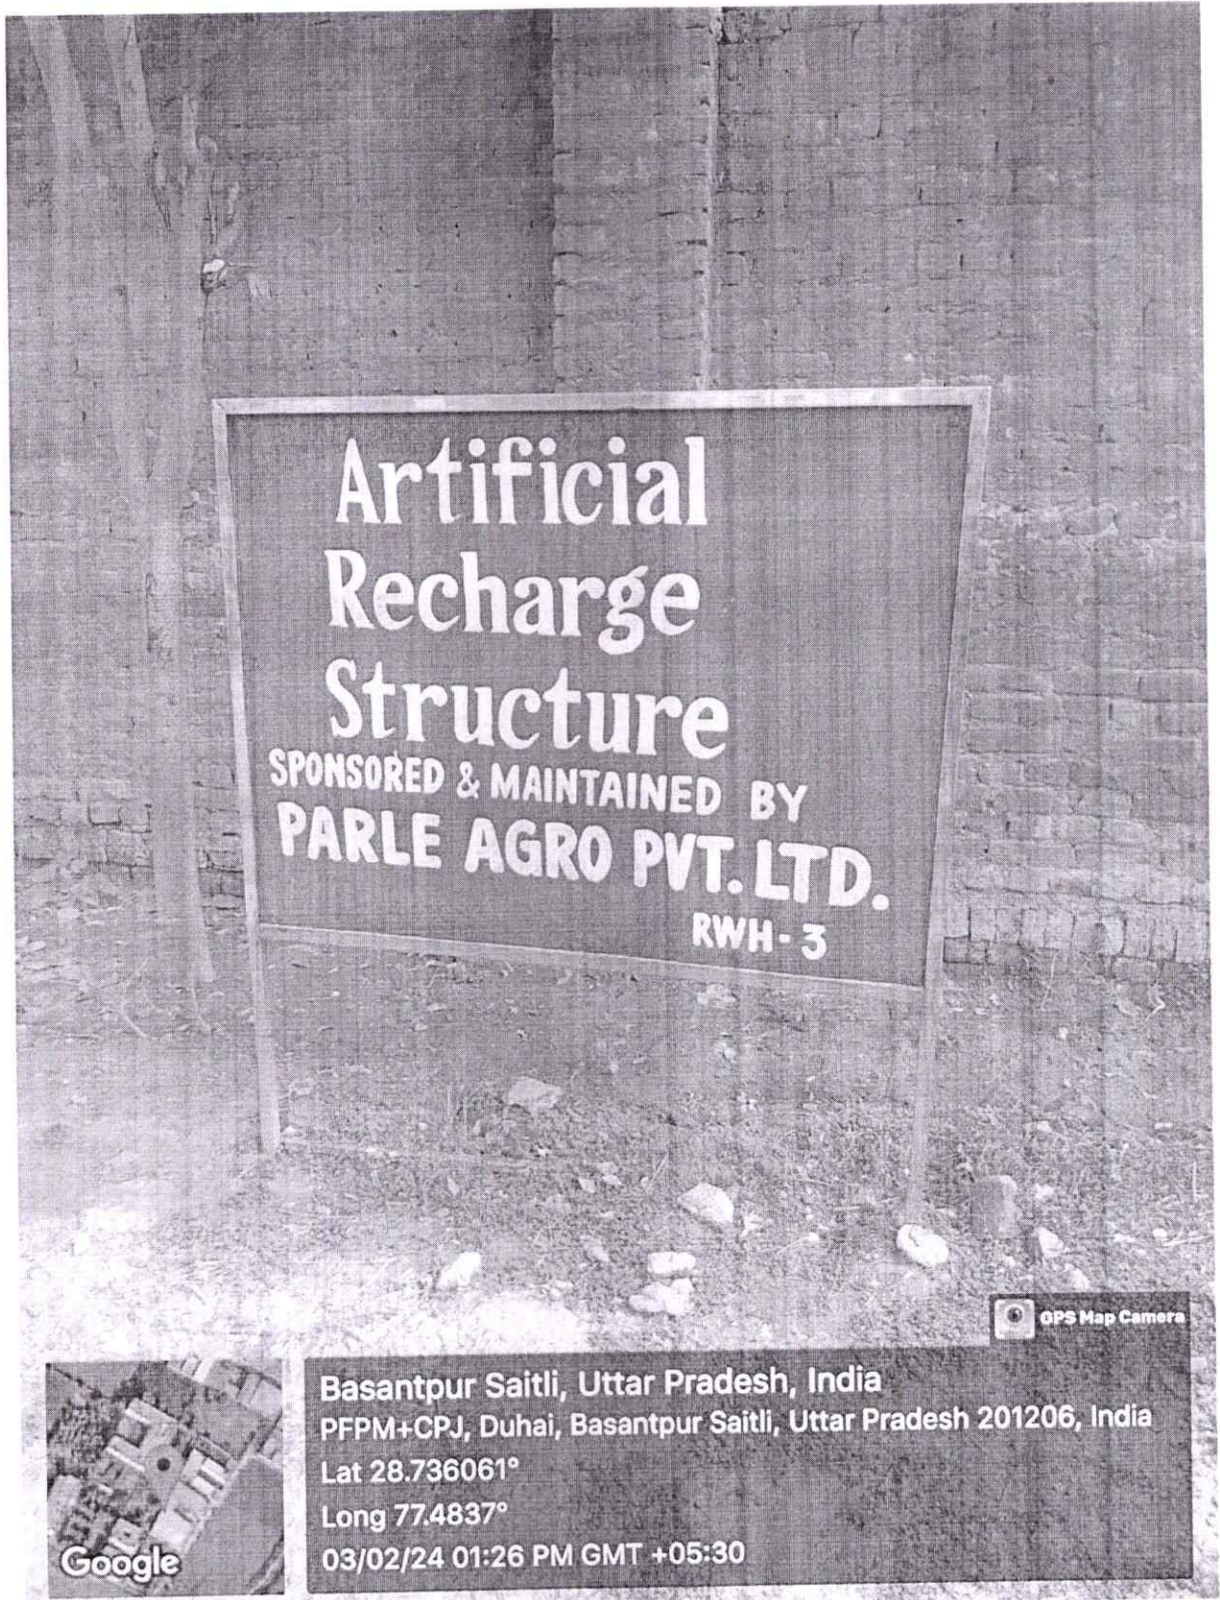

**Artificial
Recharge
Structure**
SPONSORED & MAINTAINED BY
PARLE AGRO PVT. LTD.
RWH-3




Basantpur Saitli, Uttar Pradesh, India
PFPM+CPJ, Duhai, Basantpur Saitli, Uttar Pradesh 201206, India
Lat 28.736061°
Long 77.4837°
03/02/24 01:26 PM GMT +05:30

GPS Map Camera


RAIN WATER HARVESTING -3 TANK CAPACITY 1500 L


Director
R.D. Engineering College
Duhai, Ghaziabad

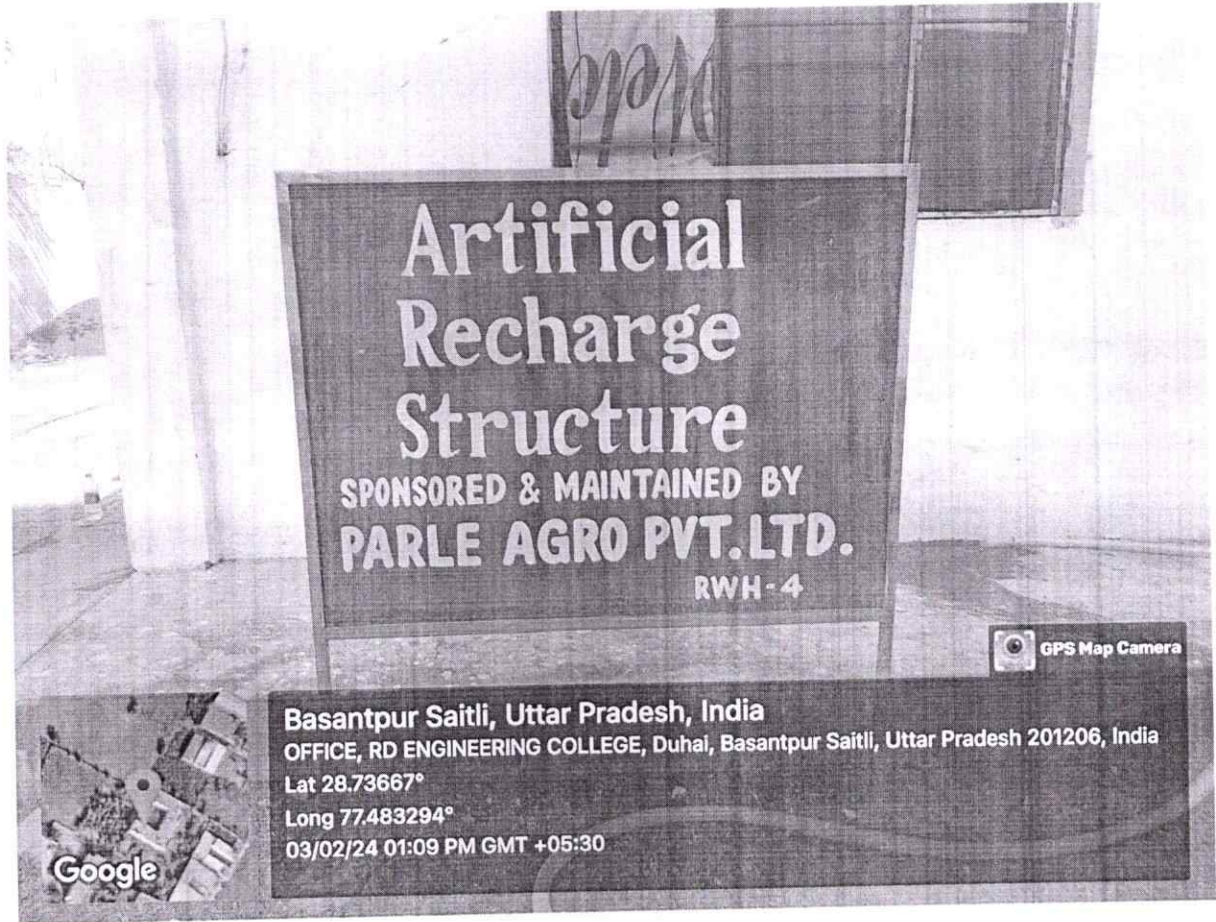

RAIN WATER HARVESTING -4 TANK CAPACITY 1500 L


Director
R.D. Engineering College
Duhai, Ghaziabad

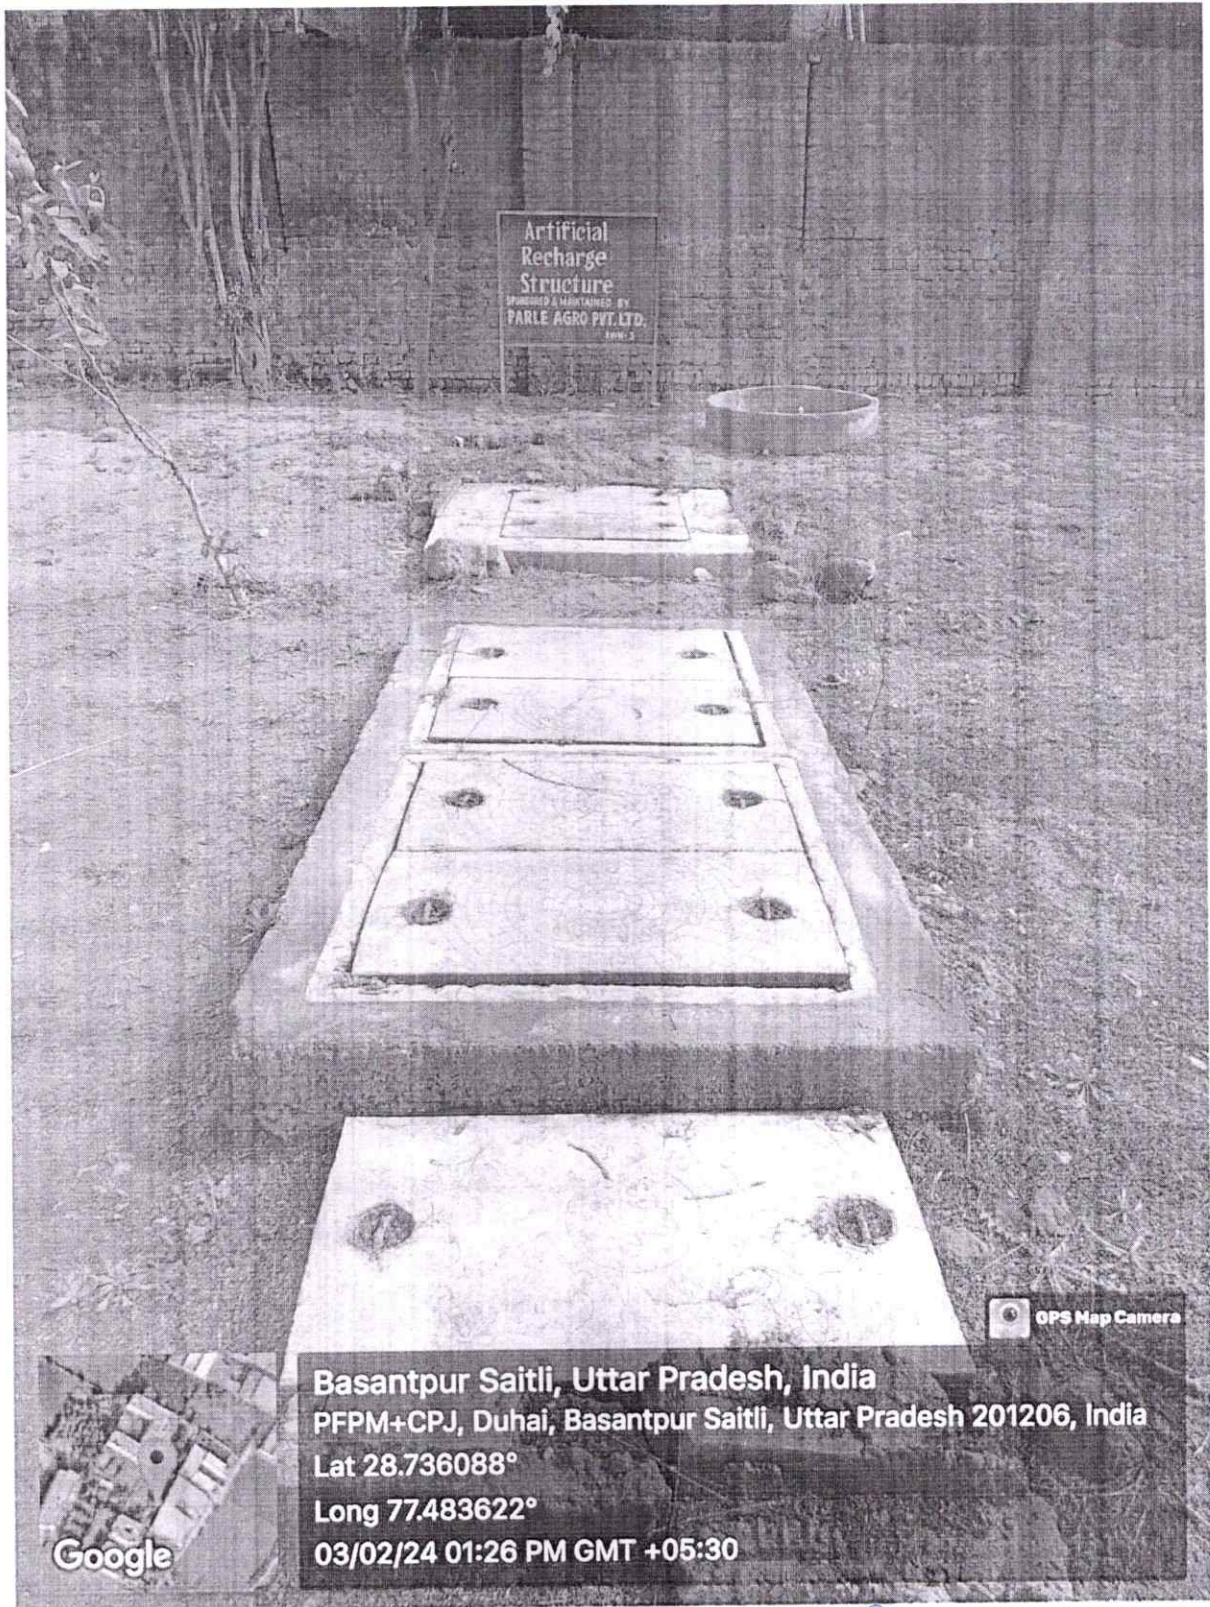

Artificial
Recharge
Structure
SPONSORED & MAINTAINED BY
PARLE AGRO PVT. LTD.
1991-3


GPS Map Camera



Google


Basantpur Saitli, Uttar Pradesh, India
PFPM+CPJ, Duhai, Basantpur Saitli, Uttar Pradesh 201206, India
Lat 28.736088°
Long 77.483622°
03/02/24 01:26 PM GMT +05:30


Director
R.D. Engineering College
Duhai, Ghaziabad

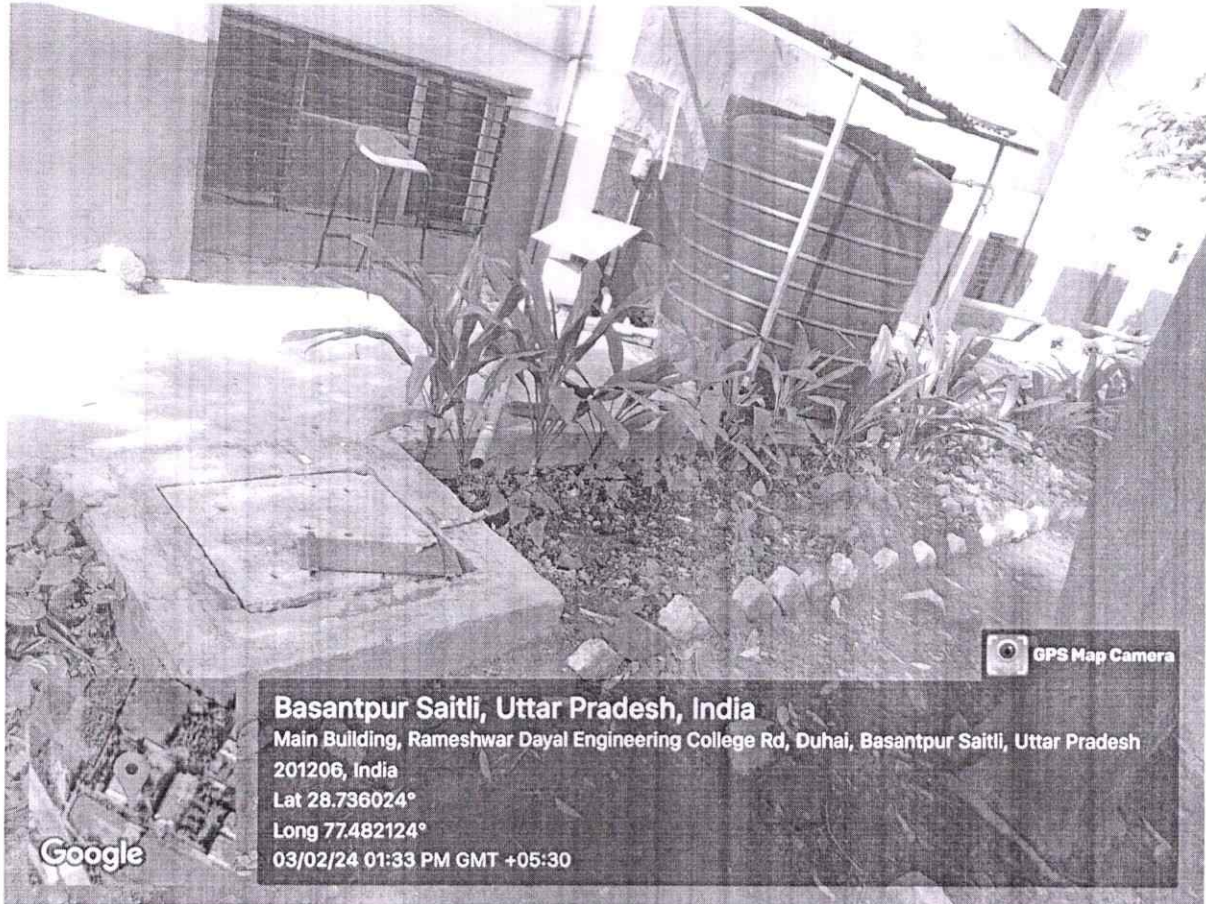


INLET AND OUTLET PIPES FOR GROUND TANK CAPACITY 1000 L


Director
R.D. Engineering College
Duhai, Ghaziabad

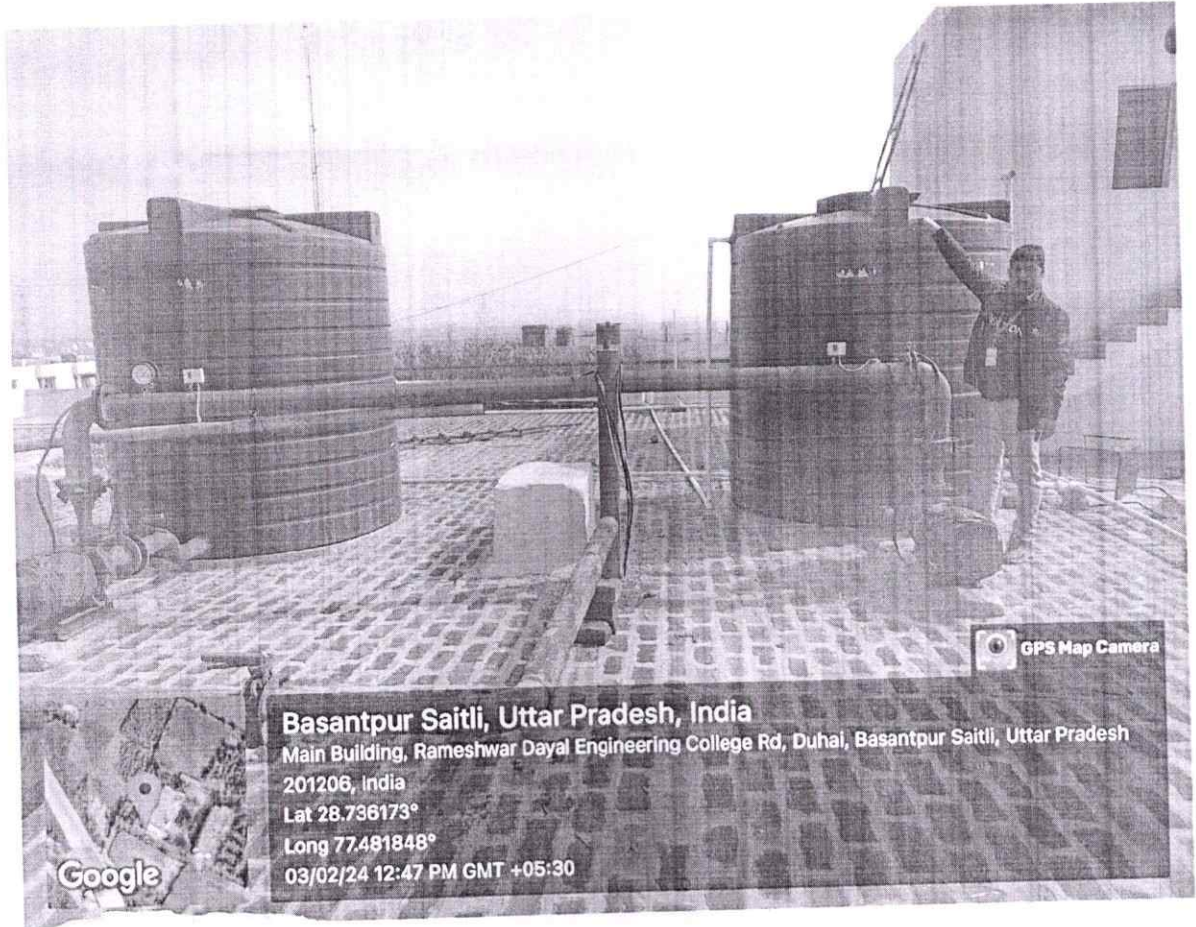

INLET AND OUTLET PIPES ROOF TOP TANK CAPACITY 2000 L


Director
R.D. Engineering College
Duhai, Ghaziabad

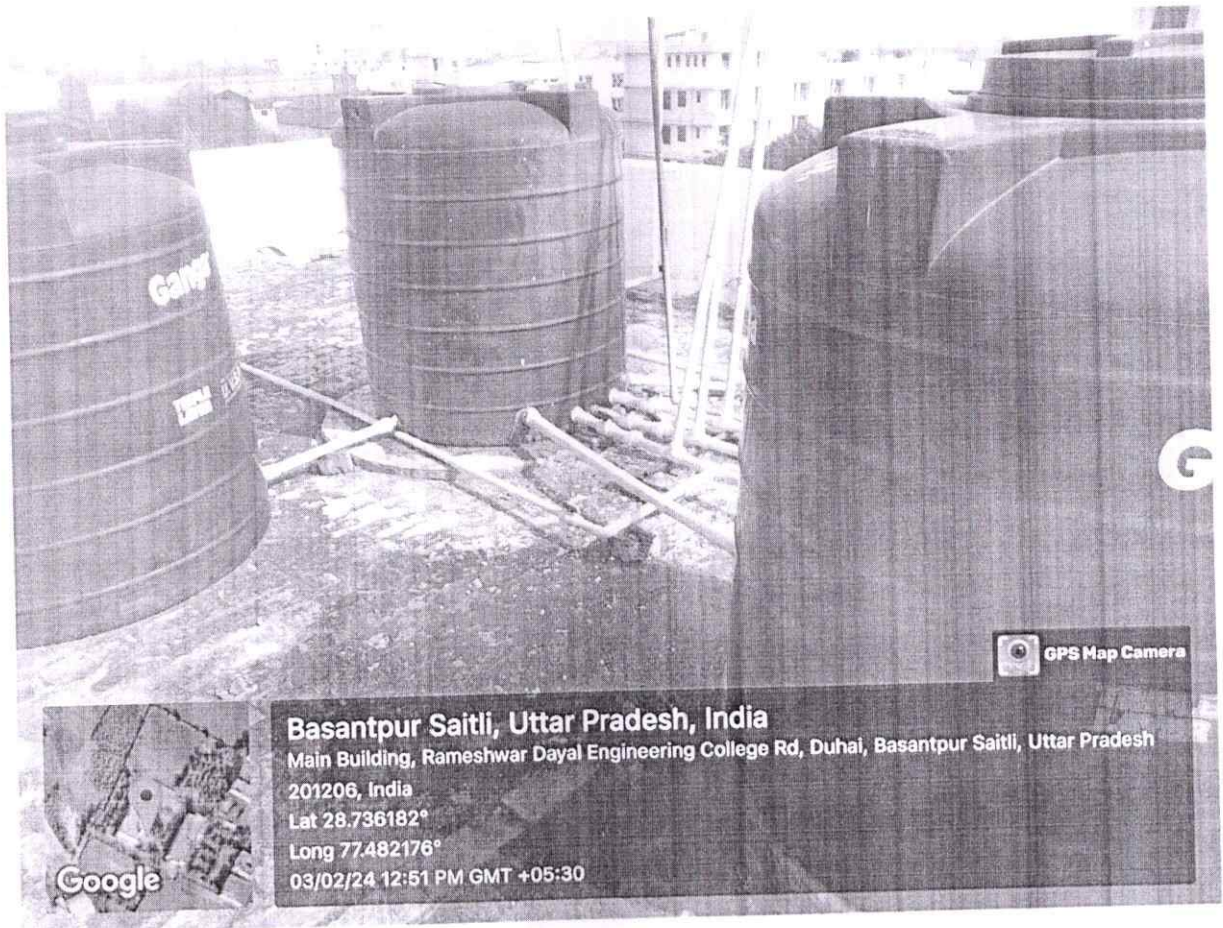

**INLET AND OUTLET PIPES ROOF TOP TANK CAPACITY
1000 L**


Director
R.D. Engineering College
Duhai, Ghaziabad



AICTE ID: 1-3548321

College Code: 231

R. D. ENGINEERING COLLEGE

Approved by AICTE New Delhi & Affiliated to Dr. APJ Abdul Kalam Technical University, Lucknow under the aegis of IQAC

Water Management Policy

R D Engineering College, Ghaziabad has following water management policy:

1. Ground water through submersible pump with following detail connected with the overhead water storage tank capacity in academic block and hostels (Boys and Girls).

WATER CAPACITY DETAILS					
SR. NO.	SUBMERSIBLE PUMP CAPACITY	LOCATION	CAPACITY	QUANTITY	TOTAO STORAGE
1	10 hp	A-BLOCK	5000	1	5000 LTRS
			1000	6	6000 LTRS
2	10 hp	B-BLOCK	5000	1	5000 LTRS
			2000	1	2000 LTRS
3	3 hp	C-BLOCK	5000	1	5000 LTRS
			2000	1	2000 LTRS
4	1.5 hp	HOSTEL GIRLS	5000	1	5000 LTRS
5	3 hp	HOSTEL BOYS	2000	7	14000LTRS
6	1.5 hp	CANTEEN	1000	3	3000 LTRS

2. Drinking water is supplied through RO plant installed in campus.
3. We have 2 plumbers for maintenance of water supply and sewage line related issues in the campus.
4. We have Rain Water Harvesting at 4 places in the campus.


Registrar
R.D. Engineering College
Ghaziabad
Registrar-RDEC


Director
R.D. Engineering College
Duhai, Ghaziabad